


This is a fixed installation all connections should be carried out by a competent person.

The control switch must be installed for maintenance reasons.


All cables supplied at 2m, extendable to 10m with appropriate cable.

For automatic operation the thermostat needs to be switched on. For manual operation using the control switch the thermostat needs to be switched off.

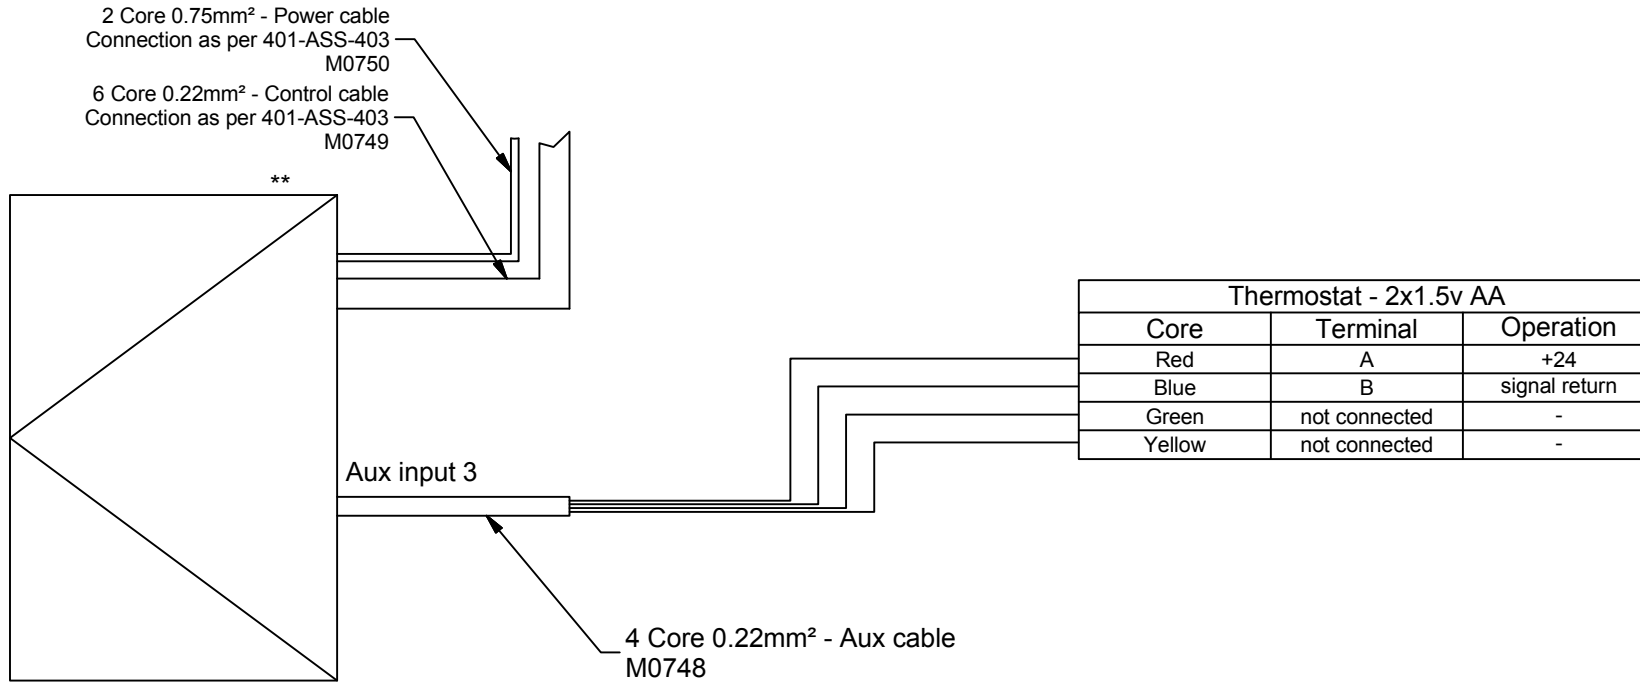

**Cables exit from the underside refer to kerb drawing 401-ASS-401 for detailed exit position

All optional items must be specified at time of order

 <p>Saw Mills Road Diss Norfolk IP22 4RG</p> <p>Tel: +44 (0)333 8000 881 Fax: +44 (0)333 8000 882 Email: sales@glazingvision.co.uk Website: www.glazingvision.co.uk</p>	<p>IT IS GLAZING VISION'S POLICY TO CONTINUOUSLY DEVELOP AND IMPROVE OUR PRODUCTS. WE THEREFORE RESERVE THE RIGHT TO MODIFY OR CHANGE THE DETAIL DESIGN AT OUR DISCRETION AND WITHOUT PRIOR NOTICE. THIS DRAWING IS COPYRIGHT AND THE SOLE PROPERTY OF GLAZING VISION LTD. THE DESIGNS/INFORMATION IT CONTAINS ARE PRIVATE AND CONFIDENTIAL. IT MUST NOT BE COPIED, EXHIBITED OR COMMUNICATED TO THIRD PARTIES FOR ANY PURPOSE OTHER THAN THAT FOR WHICH IT WAS ISSUED WITHOUT THE WRITTEN PERMISSION OF GLAZING VISION LTD.</p>	<p>Third angle projection unless otherwise noted. Tolerances: Whole numbers = ±1mm One decimal place = ±0.5mm Two decimal places = ±0.2mm All angles 90±0.5 degrees unless specified IF IN DOUBT - ASK! DO NOT SCALE Supplier to deburr & remove sharp corners</p>	Rev	Revision Description	Drawn/Date	Product: 401 - GV Standard VisionVent		Checked By:
			-	Initial release - Drawing replaces E0010	JamesB 12.05.14	Description: VisionVent thermostat wiring diagram		MM
			A	New controller MA0106 with Aux 3 input.	JWL 12.07.16	Materials: N/A		Check Date: 12.07.16
						Finish: N/A		
						Weight: N/A		Drawn By: JamesB Drawn Date: 12.05.14
Scale: N/A		Drawing No: 401-ASS-417						