


This is a fixed installation all connections should be carried out by a competent person.

A mains supply must be available on site when the unit is installed otherwise it may not be possible to fully commission the rooflight. Additional visits will incur additional charges.


The control switch must be installed on all units for maintenance reasons.

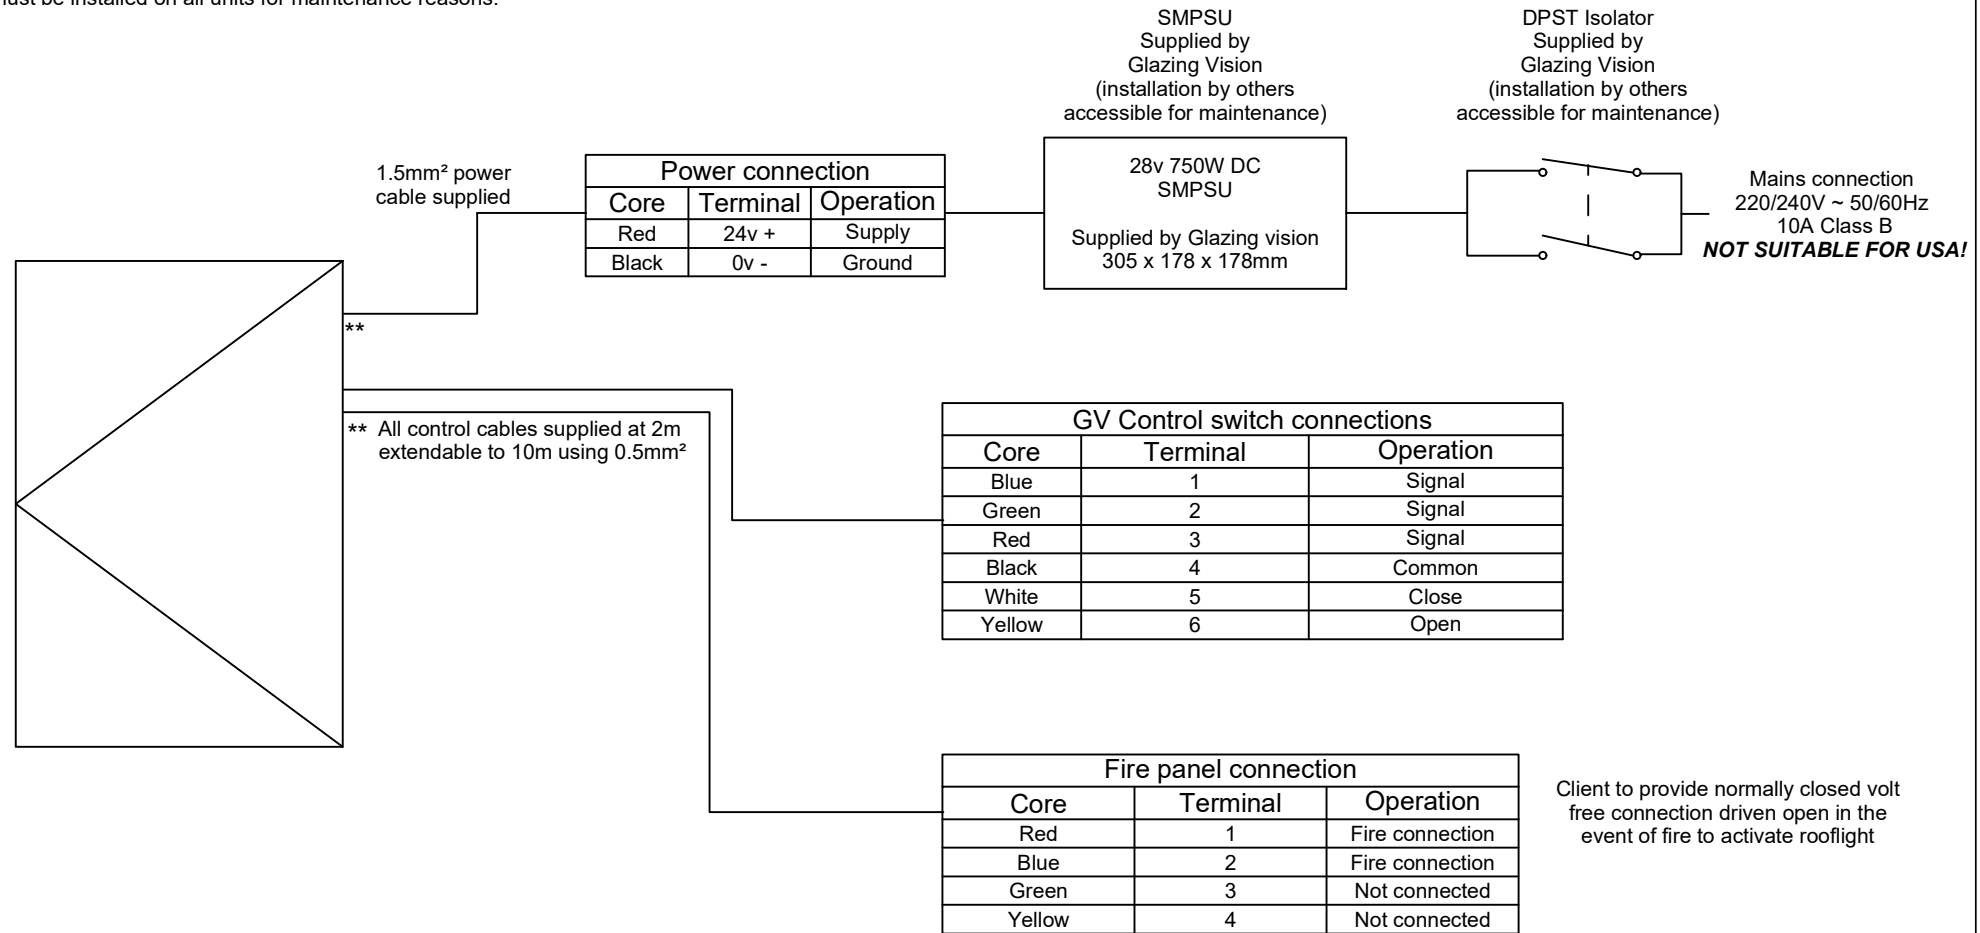

Client to provide normally closed volt free connection driven open in the event of fire to activate rooflight

**Cables exit from the underside refer to kerb drawing 405-ASS-405 for detailed exit position

All optional items must be specified at time of order

 <p>Saw Mills Road Diss Norfolk IP22 4RG</p> <p>Tel: +44 (0)333 8000 881 Fax: +44 (0)333 8000 882 Email: sales@glazingvision.co.uk Website: www.glazingvision.co.uk</p>	<p>IT IS GLAZING VISION'S POLICY TO CONTINUOUSLY DEVELOP AND IMPROVE OUR PRODUCTS. WE THEREFORE RESERVE THE RIGHT TO MODIFY OR CHANGE THE DETAIL DESIGN AT OUR DISCRETION AND WITHOUT PRIOR NOTICE. THIS DRAWING IS COPYRIGHT AND THE SOLE PROPERTY OF GLAZING VISION LTD. THE DESIGNS/INFORMATION IT CONTAINS ARE PRIVATE AND CONFIDENTIAL. IT MUST NOT BE COPIED, EXHIBITED OR COMMUNICATED TO THIRD PARTIES FOR ANY PURPOSE OTHER THAN THAT FOR WHICH IT WAS ISSUED WITHOUT THE WRITTEN PERMISSION OF GLAZING VISION LTD.</p>	<p>Third angle projection unless otherwise noted. Tolerances: Whole numbers = ±1mm One decimal place = ±0.5mm Two decimal places = ±0.2mm All angles 90±0.5 degrees unless specified IF IN DOUBT - ASK! DO NOT SCALE Supplier to deburr & remove sharp corners</p>	<p>Rev</p>	<p>Revision Description</p>	<p>Drawn/Date</p>	<p>Product: 405 - GV Standard X-Vent Description: X-Vent client wiring diagram</p>	<p>Checked By: MJM</p>
			B	1.5mm2 note added to power cable	JSL 22.02.18	<p>Materials: N/A Finish: N/A</p>	<p>Check Date: 24/07/2019</p>
			C	Green & yellow added to fire panel. BMS removed. To suit MA0106 controller.	JSL 24/07/2019	<p>Weight: Quantity: N/A Scale: N/A</p>	<p>Drawn By: JamesB Drawn Date: 28.04.14</p>
					<p>Drawing No: 405-ASS-407</p>		